

ASBESTOS MATERIALS REGISTER

Report ID: 28231r1 – supersedes
28231r0

Prepared for: City of Kalamunda



December 2021

**Building 7252 – Kalamunda Library, 50
Railway Road, Kalamunda WA 6076**

Reinspection conducted by City of Kalamunda



Document Revision and Updates

Author	Rev	Date	Signature	Revision Details	Authorised Recipient
Elise Chiappalone	r0	13/07/2021		Original Documentation	Aleck Nortje City of Kalamunda
Elise Chiappalone	R1	28/06/2022		Update following annual inspection conducted by City of Kalamunda. NATA Endorsement removed.	Aleck Nortje City of Kalamunda

Prior to use of this Register and Management Plan, QED Environmental Services should be contacted to confirm that this is the latest revision. Please phone 1300 400 733 and quote Report ID 28231r1 – supersedes 28231r0.

The enclosed report has been authorised by the following QED Environmental Services Signatory

Elise Chiappalone

Senior Consultant
Asbestos Assessor Class A

© QED Environmental Services Pty Ltd (QED)

Copyright in the information recorded in this document is the property of QED. This document and the information are solely for the use of the authorised recipient and this document may not be used, copied or reproduced in whole or part for any purpose other than that for which it was supplied by QED. QED makes no duty, and accepts no responsibility to any third party who may use or rely upon this document or the information contained within.

TABLE OF CONTENTS

EXECUTIVE SUMMARY	4
<i>Limitations</i>	<i>4</i>
INTRODUCTION	5
Scope	5
Class of Assessment	5
Methodology	6
Limitations	6
NON-ASBESTOS MATERIAL REGISTER	7
COPIES OF LABORATORY CERTIFICATES OF ANALYSES	9
GLOSSARY OF TERMS	20
ASBESTOS MATERIAL REGISTER COMPOSITION & RISK ASSESSMENT	22
The Workplace Registers	22
Content	22
Identification Phase	22
Evaluation Phase	23
Control Phase	26

ASBESTOS MATERIALS REGISTER

**BUILDING 7252 – KALAMUNDA LIBRARY, 50 RAILWAY ROAD,
KALAMUNDA WA 6076**

EXECUTIVE SUMMARY

QED Environmental Services was commissioned by City of Kalamunda to audit the building located at Building 7252 – Kalamunda Library, 50 Railway Road, Kalamunda WA 6076 (referred to as the “site”). Specifically the scope of works includes the following:

1. Asbestos register

The methodology employed by QED Environmental Services is consistent with the Code of Practice for the Management and Control of Asbestos in workplaces [NOHSC: 2018 (2005)].

The processes and procedures implemented for these works have been independently assessed by the National Association of testing Authorities, Australia (NATA).

Elise Chiappalone from QED Environmental Services (Asbestos Assessor) conducted the site inspection on 18 March 2021.

City of Kalamunda’s Asset Inspector (completed CPCBC4023A – *Plan and undertake site inspection and assessment of asbestos products and materials* through Australian Training Management) conducted a reinspection on 6 December 2021. He has not been trained by QED Environmental Services and has not followed procedures in accordance with our quality management system. This report may therefore not be considered to be endorsed under QED’s NATA accreditation. QED accepts no responsibility for the findings of such reinspection which have been incorporated into this report on an as-received and unverified basis.

No asbestos containing materials were identified, suspected or presumed on site as per the class of assessment (Management Survey). As such, there is no requirement for further reviews as per [NOHSC: 2018 (2005)] unless refit or demolition works are planned. In this instance it is recommended that an intrusive survey be conducted on the building which is a different class of assessment

An Asbestos Management Plan has been prepared separately and is available from City of Kalamunda, Coordinator Building Maintenance, Aleck Nortje – (08) 9257 9682.

Limitations

QED Environmental Services has endeavoured by best practice procedures to locate and identify the presence of Asbestos; however, the findings summarised in this report should not be deemed absolute.

This is a non-intrusive, presumptive survey report and is not to be used for any invasive activity that may result in the disturbance of unidentified asbestos. Such activities may include, but are not limited to whole or part building demolition, rectification of the HVAC system, lift upgrades, electrical upgrades, slab penetrations, roofing works.

This report has been prepared for the use of the City of Kalamunda, and is not to be relied upon by any third party without prior consultation with QED. QED may not be held responsible by City of Kalamunda or any other party for the findings of a reinspection incorporated in this report. This report is not to be used as a contractual document.

Detailed information regarding the report limitations are described in the Introduction section.

INTRODUCTION

Scope

In keeping with the appropriate State and Commonwealth Legislation, the scope of this report is to assess the nature and condition of in-situ asbestos-containing materials within the building fabric and general services, and to assess the potential for building occupants to be exposed to airborne asbestos fibres.

The scope of work specified for the site survey excludes invasive investigative techniques and subsequently this report is not to be used in the event of building demolition.

Class of Assessment

The United Kingdom has developed a minimum standard for the surveying and sampling of asbestos containing material in the commercial sector. The standard identifies two types of survey which may be used, depending on the purpose for which the results of the survey are to be used. The two types are:

Management Survey. The assessor locates, as far as reasonably practicable, the location, extent and condition of suspect asbestos containing material (ACM) that may be damaged or disturbed during normal occupancy or foreseeable maintenance activities. This type of survey may involve minor intrusive work and some disturbance. The materials are assessed in relation to their condition and their ability to release fibres into the air.

Refurbishment and Demolition Survey. The assessor locates, as far as reasonably practicable, all asbestos containing materials in the area to be refurbished or demolished. The survey is fully intrusive and will involve destructive inspection. This type of inspection may also be necessary prior to more intrusive maintenance or repair work will be carried out, or where plant is to be removed or dismantled.

The surveys are completed by appropriately trained and experienced surveyors, who assess the following aspects of any ACM identified:

- product type
- location
- extent
- accessibility
- likelihood of disturbance
- amount of damage/deterioration (in the case of the *Refurbishment and Demolition Survey*, this is only required if the asbestos removal may not take place for some time.)

Source: HSG264 *Asbestos: The survey guide* (Health and Safety Executive (2012)).

In this case a *Management Survey* has been used by QED in order to develop the appropriate Asbestos Register and Management Plan. Sampling of materials has been conducted wherever practical. The Asbestos Register and Management Plan also include findings of a reinspection by City of Kalamunda for which QED may not be held responsible.

Sampling during the original inspection was conducted by QED, and the samples deposited at the City of Kalamunda building maintenance office at the works depot. The City of Kalamunda was responsible for the handling of the samples from this time. QED is not liable for breakdown in the chain of custody or other procedural errors or omissions, and is also not liable for sampling and handling of samples during any reinspection.

Methodology

The general methodology employed by QED is consistent with HSG264 *Asbestos: The survey guide* (Health and Safety Executive (2012) and is also in accordance with National Code of Practice for the Control of Workplace Hazardous Substances [NOHSC: 2007(1994)] and *Asbestos* (April 2005) in Workplaces.

Code of Practice for the Management and Control of Asbestos in Workplaces, NOHSC: 2018, (2005) National Occupational Health & Safety Commission, Canberra, April 2005.

This involves 3 phases; Identification, Evaluation and the Control Phase. This report details the Identification and Evaluation Phases, and provides recommendations of the Control Phase. The sampling and assessment of suspect materials was conducted by QED personnel from visible building and plant materials with minimal disturbance, and samples sent to an independent NATA certified laboratory for analysis.

Following a survey by QED, a reinspection was conducted by staff of City of Kalamunda who have not been trained by QED Environmental Services and have not followed procedures in accordance with our quality management system. This report may therefore not be considered to be endorsed under QED's NATA accreditation.

Limitations

Non-destructive sampling is restricted by physical, safety and security constraints of access, and a number of operational limitations, protocols and codes of practice (WorkSafe) that restrict any building inspection.

Note that no inspection can guarantee to identify all materials subject to investigation present in a building, thus due to accessibility and scope constraints there is a possibility that additional Asbestos material may exist within the building which are not identified in the registers. In some instances, materials subject to investigation may be present in inaccessible areas such as:

- Wall cavities
- Locked or blocked off areas
- Beneath floors
- Elevator shafts
- Slabs
- Integral parts of boilers, pumps, machinery, plant and pipework
- Reheat units within air conditioning ducts; and
- Fire doors.

Confirmation of lagged pipework in wall cavities and that which may be “chased” into walls is not possible with a visual inspection in a non-destructive survey. Any scheduled demolition or upgrading works should allow for specific inspections to be undertaken in order to determine if asbestos is present in such areas.

In addition, the following areas specific to this site were inaccessible on this occasion:

- No areas.

NON-ASBESTOS MATERIAL REGISTER

Building Address: Building 7252 – Kalamunda Library, 50 Railway Road, Kalamunda WA 6076



Construction: Brick and Sheet metal.

Year of Construction: 1987.

Assessor: Graeme Clarke

Date of Assessment: 7 December 2021

No asbestos containing materials were identified, suspected or presumed on site as per the class of assessment (Management Survey).

Item Description	Lab No.	Location		Comments
Gable ends.	SERS Job Number 159414.	Gable end cladding to all 4 around the roof space.		No asbestos detected. Information taken from the City of Kalamunda register: Building: Kalamunda Library Asset ID: BD_0502-00 Date Inspected: 11-Dec-2019
Cable pit surrounds.	Removed.	Southwest corner paving under veranda.		Replaced between the 2019 and 2021 audits.
Vinyl floor sheeting.	Greencap Report No. 41949. QED ID: 32439.	Cleaner's store, office, kitchen and storeroom.		No asbestos detected.

Item Description	Lab No.	Location			Comments
Under Sink Membrane.	ARL Lab No. 21-10098-26. QED ID: 32440.	Storeroom adjacent to the family reading collection room.			No asbestos detected.
Entrance panelling.	ARL Lab No. 21-10098-27. QED ID: 32441.	Main entrance canopy.			No asbestos detected.
Fibre cement columns.	ARL Lab No. 21-10098-28. QED ID: 32442 .	Main entrance canopy.			No asbestos detected.

COPIES OF LABORATORY CERTIFICATES OF ANALYSES



SERS
Site Environmental and Remediation Services

Office Locations

Brisbane 95 Sandgate Road Alton QLD 4010	Darwin 48 - 50 Smith Street Darwin NT 0800	Melbourne 14, 380 St Kilda Rd Melbourne VIC 3004	Perth 281 Newcastle Street Northbridge WA 6003	Sydney 5/2 Bennett Street Marsfield NSW 2157
---	---	---	---	---

Phone
1300 320 696

Email
reception@sers.net.au

LABORATORY FIBRE IDENTIFICATION CERTIFICATE OF ANALYSIS – BULK ANALYSIS

Job Number	159414	Date Sampled	Not Provided
Purchase Order Number	121968	Sampled By	As Received from Client
Client	City of Kalamunda	Address Of Sampling Site	Kalamunda Library
Client Address	2 Railway Road, Kalamunda	Number Of Samples	1
Contact	Brayden Thomas	Date Received At Laboratory	12 February 2020
Telephone	(08) 9257 9999	Date Analysed	13 February 2020
Email	Not Provided	Laboratory Location	SERS Laboratory Perth

SERS Lab Sample No.	Client Sample No.	Sample Location	Sample Dimension (mm/g)	Sample Material Description	Fibres Identified In Material
1	-	Gable Ends	75 x 50 x 10	Fibre Board	NAD, ORG

Legend	
NAD	No Asbestos Detected
NADRL	No Asbestos Detected at Reporting Limit of 0.1g/kg
CHR	Chrysotile Asbestos Detected
AMO	Amosite Asbestos Detected
CRO	Crocidolite Asbestos Detected
UMF	Unknown Mineral Fibres Detected
SMF	Synthetic Mineral Fibres Detected
ORG	Organic Fibres Detected

Method: Samples submitted to SERS laboratory for qualitative fibre identification are subjected to polarised light microscopy including dispersion staining techniques. Examination of samples is completed in accordance with AS4964-2004 Method for the qualitative identification of asbestos in bulk samples and SERS in-house method LAB PR002 Fibre Identification.

Comments: SERS accepts no responsibility for the collection, packaging or transportation of samples submitted by external persons. All samples are analysed as received and results relate specifically to the samples submitted for testing. Sample location is only reported if provided by the client. Samples reported 'As received by client' are at the discretion of the client/individual submitting the sample providing the correct and true information. SERS accepts no responsibility for any misrepresentation of incorrect sample locations provided by the client/individual submitting the sample. If a sample material description is not provided by the client, the laboratory will provide a description which may be limited by the condition of the sample on submission. This report must only be reproduced in full.



Accredited for compliance with ISO/IEC 17025 – Testing
NATA accreditation number 18508
*Darwin, Sydney & Melbourne are not SERS accredited testing facilities

Approved Identifier:
Sheralynn Seah (Laboratory Manager)

Approved Signatory:
Sheralynn Seah (Laboratory Manager)



LAB FM007 Laboratory Fibre Identification Report - Bulk Analysis Version 7 27/05/2019

www.sers.net.au
Page 1 of 2



APPENDIX A – TRACE ANALYSIS


SERS Lab Sample No.	Client Sample No.	Sample Location	Trace Analysis
1	-	Gable Ends	NAD

Comments: Trace analysis has been completed in accordance with AS4964-2004 Method for the qualitative identification of asbestos in bulk samples and SERS in-house method LAB PR002 Fibre Identification and samples have been subjected to polarised light microscopy including dispersion staining techniques. Trace analysis is completed on homogeneous samples where asbestos is not evident, and on all non-homogeneous samples (i.e. dust, soils, aggregates). Where asbestos has been detected in a sample and the trace analysis result has "No Asbestos Detected", the sample should be treated as asbestos containing material.

END OF REPORT

**Note: SERS lab certificates taken from Information taken from the City of Kalamunda register:
Building: Kalamunda Library, Asset ID: BD_0502-00, Date Inspected: 11-Dec-2019**


**Building 7252 – Kalamunda Library, 50 Railway Road, Kalamunda WA 6076
Report ID: 28231r1 – supersedes 28231r0**



NATA
WORLD RECOGNISED
ACCREDITATION

This document shall not be reproduced, except in full. Accredited for compliance with ISO/IEC 17025 - Testing. Accreditation No. 5450, Site No. 18611 Adelaide Laboratory. The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.

The information for the entries in the top table, with the exception of date received and date analysed, is provided by the client. The results relate only to the samples tested and are for the sole use by the client.



GREENCAP
Going Further in Managing Risk

Greencap Pty Ltd
ABN: 76 006 318 010
12 Greenhill Road
Wayville SA 5034 Australia
T: 08 8299 9955


Asbestos Identification by PLM and Serpentine by XRD Report: 41949

CLIENT:	QED Environmental Services	ORDER NO:	EC28231
ATTENTION:	Elise Chiappalone	RECEIVED IN LAB:	25 March 2021
SAMPLED BY:	Elise Chiappalone	DATE ANALYSED:	26 March 2021
CLIENT CONTACT:	1300 400 733		

All sample analysis was performed using polarised light microscopy, including dispersion staining, in our Adelaide Laboratory by the method of Australian Standard AS 4964-2004 and supplementary work instruction in-house method LAB04 Asbestos Identification by PLM and/or LAB05 Serpentine Detection by X-ray diffraction.

Client ID	Sample Size	Description	Asbestos by PLM	Chrysotile* by XRD
32439	20x20x2mm	Off-white vinyl sheet		No
	10x10x1mm	Transparent adhesive	No	

*Chrysotile (commonly known as white asbestos) is the only asbestos type reported, because it is the only type of asbestos known to be added to vinyl layers.



Approved Identifier (PLM) and Testing Officer (XRD) and Signatory (PLM/XRD)
Sophie Toth

Please note that the results contained in this report relate only to the sample(s) submitted for testing. Sample Size and Descriptions are approximate only. PLM = Polarized Light Microscopy, XRD = X-ray diffraction. Chrys = Chrysotile. Chrysotile is commonly known as white asbestos and is a Serpentine mineral. Amosite is commonly known as brown asbestos and Crocidolite as blue asbestos. SMF (Synthetic Mineral Fibre) is commonly known as glass fibre. Organic Fibre includes natural fibres and synthetic organic fibre. A blank in the Organic Fibre or SMF column or the absence of an Organic Fibre or SMF column implies not detected. A blank in the PLM or XRD columns implies not tested by this method. If the symbol ^ is used above, this indicates that the presence specifically of chrysotile is not covered by NATA accreditation. A serpentine mineral was detected by XRD, a result which is covered by NATA accreditation.

41949-ID-XRD, EC28231, 2021-03-26 Report Date: 26 March 2021 Page 1 of 1

Any and all services carried out by Greencap for the Client are subject to the Terms and Conditions listed on the Greencap website <https://www.greencap.com.au/terms-conditions> and are governed by our statements of limitation available at <https://www.greencap.com.au/statements-limitation>.

[greencap.com.au](https://www.greencap.com.au)

Adelaide | Auckland | Brisbane | Canberra | Darwin | Melbourne | Perth | Sydney | Wollongong



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

ADDRESS: City of Kalamunda
PO Box 42
Kalamunda WA 6928

ATTENTION: Jonathan Smith


DATE RECEIVED: 1/08/2021


YOUR REFERENCE: LHACC Kalamunda sampling

PURCHASE ORDER:

APPROVALS:




Ivan Hodgson
Approved Identifier


Ivan Hodgson
Approved Signatory

SAMPLING COMMENTS:

Samples are analysed on an "as received" basis

METHOD REFERENCES:

Method ID	Method Description
ASBID	Qualitative identification of fibre type in bulk samples by Stereo Microscope Examination and Polarised Light Microscopy, including Dispersion Staining, using ARL in-house method ASBID and in accordance with AS4964-2004.

REPORT COMMENTS:

This report is issued by Eurofins ARL Pty Ltd, NATA accreditation number 2377. The report shall not be reproduced except in full without written approval from the laboratory.

* The fibres detected may or may not be asbestos fibres. To confirm the identities, another independent analytical technique may be required.

RESULTS:

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos in Bulk Sample
[Redacted Results]				

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample
21-10098-26	Kalamunda Library - 1	Bitumen	0.4	No Asbestos Detected Organic Fibres Detected
21-10098-27	Kalamunda Library - 2	Cement	0.2	No Asbestos Detected Organic Fibres Detected
21-10098-28	Kalamunda Library - 3	Cement	0.1	No Asbestos Detected Organic Fibres Detected



Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 2 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



ARL

Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 3 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



ARL

Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 4 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 5 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 6 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 7 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 8 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.



Job Number: 21-10098
Revision: 00
Date: 2 July 2021

LABORATORY REPORT

Sample No	Sample Details	Sample Type	Sample Weight (Approx. g)	Asbestos In Bulk Sample

Eurofins | ARL
46-48 Banksia Road, Welshpool, Western Australia 6106 Telephone: 08 6253 4444

Page 9 of 9

NB. Results not related to this report have been redacted from the above laboratory certificate of analysis.

GLOSSARY OF TERMS

Accredited Laboratory: Means a testing laboratory accredited by the National Association of Testing Authorities (NATA) Australia

Asbestos: Includes chrysotile, amosite, crocidolite, tremolite, anthophyllite, actinolite, and any of these minerals that has been chemically treated and/or altered.

ACM: Asbestos-containing material.

Asbestos Management Planner: Means a person employed to interpret survey results make hazard assessment, evaluation and selection of control options or develop an operation and maintenance plan.

Authorised Person: Means any person authorized by the employer and required by work duties to be present in regulated areas.

Code of Practice: A code of practice is defined in the Occupational Health and Safety Act as a document prepared for the purpose of providing:

- practical advice on preventive strategies; and
- practical means of achieving any code, standard, rule, provision or specification relating to occupational safety or health in Western Australia.

Competent Person: Means a person who is capable of identifying existing asbestos hazards in the workplace and selecting the appropriate control strategy for asbestos exposure

Demolition: Means the wrecking or taking out of any load-supporting structural member and any related razing, removing, or stripping of products.

Disturbance: Means activities that disrupt the matrix of ACM or PACM, crumble or pulverize ACM or PACM, or generate visible debris from ACM or PACM. This term includes activities that disrupt the matrix of ACM or PACM, render ACM or PACM friable, or generate visible debris.

Encapsulate: Means the application of any material onto any asbestos containing material to bridge or penetrate the material to prevent fibre release.

Enclosure: Means the permanent confinement of friable asbestos containing materials with an airtight barrier in an area not used or designed as an air plenum.

Fibre: Means a particulate form of asbestos, 5 micrometres or longer, with a length-to-diameter ratio of at least 3 to 1

Friable: Means material which is capable of being crumbled, pulverized or reduced to powder by hand pressure and which under normal use or maintenance, emits or can be expected to emit, asbestos fibres into the air

Hazard: A source of potential harm or a situation with a potential to cause loss

Hazard Identification: The process of recognizing that a hazard exists and defining its characteristics.

High efficiency particulate air (HEPA) filter: Means a filter capable of trapping and retaining at least 99.97 percent of all particles at least 0.3 micrometres or more in diameter.

Incident: Any unplanned event resulting in, or having a potential for injury, ill-health, damage or other loss.

Likelihood: Used as a qualitative description of probability or frequency.

NAD – No Asbestos Detected: A common abbreviation reported when laboratory analysis for asbestos fibres has detected no asbestos fibres.

Presumed: Taken for granted. Used when it is taken for granted that the item contains the nominated hazardous material. This presumption is based on the belief that the item is the same as another that has been tested and confirmed to contain the nominated hazardous material (e.g. one sheet lining the eaves has been sampled and confirmed to contain asbestos, the one next to it is presumed to contain asbestos) or, by visual observation, the item is determined to contain the hazardous material. Conversely, an item can be presumed *not* to contain a hazardous material. This may presumption is typically based on the belief that, due to the age and type of the material or building i.e. >2004, it should not contain asbestos.

Regulations: Regulations have the effect of spelling out specific requirements of the legislation. Regulations may prescribe minimum standards and have a general application, or define specific requirements related to a particular hazard or particular type of work. They may also allow licensing or granting of approvals and certificates etc.

Removal: Means all operations where ACM and/or PACM are taken out or stripped from structures or substrates, and includes demolition operations.

Renovation: Means the modifying of any existing structure, or portion thereof

Risk: The chance of something happening that will have an impact. It is measured in terms of consequences and likelihood

Risk Analysis: A systematic use of available information to determine how often specified events may occur and the magnitude of their consequences

Risk Assessment: The overall process of risk analysis and risk evaluation

Risk Evaluation: The process used to determine risk management priorities by comparing the level of risk against predetermined standards, target risk levels or other criteria

Suspected: Thought to be likely. Used when the item is likely to contain the nominated hazardous material because it appears to be similar to items that historically have been found to contain that material (e.g. the eaves appear to be similar to other buildings of a similar age, which have been confirmed to contain asbestos). All suspected hazardous materials must be treated as though they are hazardous unless sampling and analysis demonstrates otherwise.

ASBESTOS MATERIAL REGISTER COMPOSITION & RISK ASSESSMENT

The Workplace Registers

Since 1996, owners & employers have been required to record and maintain a "register" of Asbestos Materials in the workplace.

Regulation 3.1, 5.15 & 5.43 of OHS Regs 1996 requires the employer, main contractor, any self-employed person or the person having control of the workplace to identify each hazard, assess the risk of injury or harm to a person resulting from each hazard and consider the means by which the risk may be reduced.

Content

In keeping with the code at a minimum the register should contain five critical parameters, nominally:

Location

Identification

Condition

Risk Assessment

Control Measures

Additionally there are three phases to an Asbestos materials workplace register: -

Identification Phase

Evaluation Phase

Control Phase

Identification Phase

The identification phase is based on observations, findings, and substance samples, from a systematic inspection of the building structure, tenancy areas, plant rooms, services risers, lift motor rooms, ceiling spaces, car parking and basement areas, and general areas accessible through the supplied keying system.

Simplistically, the methodology involves a multi-step process:

1. Retrieve and review building documentation (if available)
2. Develop an investigation procedure
3. Commence the building inspection, record findings and obtain samples
4. Laboratory test and/or analyse samples

Identification and subsequent classification of substances, is by visual examination and laboratory assessments from samples of substances that are, or may be, installed, used, produced or stored in the workplace.

Generally, samples are taken from "suspect" accessible fixtures, fittings and process products, specifically in the absence of local identification, MSD Sheets, labels and/or, on site registers.

Such samples are sent, under code, to independent laboratories for identification and, subsequently, are assessed, classified and recorded in the workplace register.

Evaluation Phase

The evaluation phase is based on observations from site and the analysis of samples reported from the independent NATA accredited laboratory.

In reviewing Asbestos substances and asbestos, it is important to understand the terms **hazard** and **risk**, which in everyday use are commonly used as synonyms, but not so in industrial hygiene, where the difference is significant.

A hazard is something or condition, which has the capability of producing adverse health or safety consequences to humans. The mere presence of the capability to harm is sufficient to classify a substance, action, or condition as a hazard or to describe such as Asbestos.

Risk is a statement, either quantitative, via statistical expression, or qualitative, via subjective expression, of the probability or likelihood that harm will actually occur.

For example, asbestos insulation in a building presents a hazard, but the risk is nil if no asbestos is released into the air.

Asbestos within Buildings is evaluated using the following;

- Existing condition
- Potential for disturbance
- Subsequent risk of exposure and risk to health

Existing Condition is assessed and rated 1 to 5 from Good to Poor.

5	Poor: Surface of material has extensive amounts of damage or deterioration and appears friable. Surface covering of material is heavily torn or in poor condition (paint heavily flaking, insulation is extensively torn). Surface shows amounts of visible fibres, dust and debris.
4	Fair to Poor
3	Fair: Surface of material shows moderate amounts of damage. Surface covering of material is torn or in moderately poor condition (small flakes of paint, thermal insulation is torn). Moderate amount of visible dust and debris.
2	Good to Fair
1	Good: Surface of material shows no visible amounts of damage or deterioration. Surface of material is covered and generally intact (painted, galvanised, coated with bitumen, thermal insulation is intact). Small amount of visible dust and debris.

Potential for disturbance is then assessed based on influencing factors, such as:


Score 0 or 1 No = 0 Yes = 1	Typical Influencing Factors
	Accessible during normal operations? i.e. common areas, accessible without ladders or steps, area unsecured
	Maintenance activities on/or in area? i.e. regularly accessed and serviced, servicing requires use of electric tools
	Subjected to Mechanical Influences? i.e. vibration of machinery, involved with moving parts, within the HVAC air supply stream, subjected to mechanical exhaust
	Subjected to Environmental Influences? i.e. weathering, rainfall, surface runoff, wind, river and coastal influences
	No Current Management Plan (<1 year), Not labelled (Score 1 for not adequately managed, Score 0 for adequately managed)

Score ≤1 Low potential for disturbance

Score 3 Medium potential for disturbance

Score 5 High potential for disturbance

The inherent risk is then calculated using the risk assessment matrix.

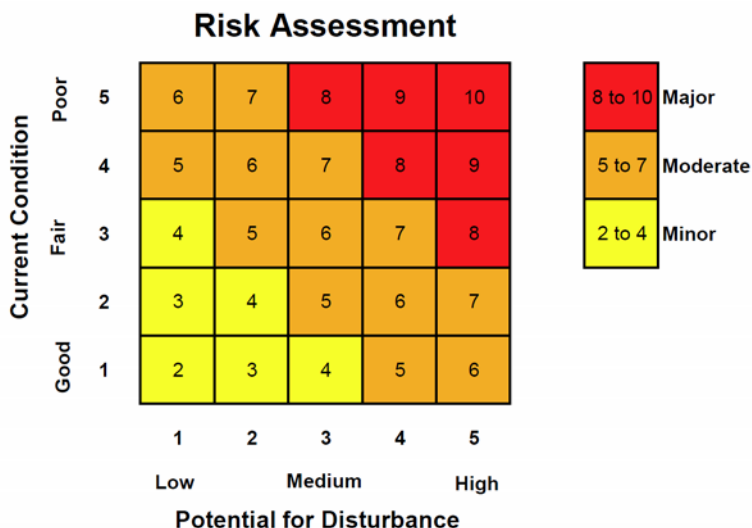

The Code of Practice for the Management of Asbestos in Workplaces defines a required action that must be undertaken, dependent on the level of risk. They are:

For inherent risks rated at 2 to 4: The ACM are not friable and are in stable condition. In accordance with [NOHSC: 2018 (2005)], ensure that they remain clearly labelled and regularly inspect to ensure they are not deteriorating or otherwise contributing to an unacceptable health risk.

For inherent risks rated at 5 to 7: IMMEDIATE ACTION REQUIRED. The ACM are friable but are in a stable condition and are accessible. In accordance with [NOHSC: 2018 (2005)], serious consideration should be given to their removal. If removal is not immediately practicable, short-term control measures, such as sealing and enclosure, may be able to be used until removal is possible. [NOHSC: 2018 (2005)].

For inherent risks rated at 8 to 10: IMMEDIATE ACTION REQUIRED. The ACM are friable and not in a stable condition, and there is a risk to health from exposure. In accordance with [NOHSC: 2018 (2005)], they should be removed by an appropriately licensed asbestos removalist as soon as is practicable.

When materials of unknown composition, or materials suspected of containing asbestos, are encountered, and are not listed in the Workplace Register, such materials should be treated as if they are asbestos until sample analysis confirms otherwise.

In the event that additional Asbestos materials are identified, a risk assessment should be conducted by an appropriately qualified and competent person, and the workplace register updated accordingly.

Control Phase

The “Hierarchy of Control Measures” is a list, in priority order, of control measures that may be employed to eliminate and/or reduce exposure to asbestos.

Notwithstanding elimination as the optimum solution, practical and cost effective control measures may be “and/or” classified as follows: -

Classification	Description
A – Elimination	A permanent solution should be attempted in the first instance.
B – Substitution	Involves replacing the material with a product that presents a lower and/or no risk.
C – Isolation	Isolation involves separation of the material from people by distance or use of barriers /encapsulation to prevent exposure.
D – Engineering Controls	Involves some structural change to the work environment or work process to place a barrier to, or interrupt the transmission path between, the worker or environment and the Asbestos material aspect. i.e. isolation and/or enclosure and/or sealing of the Asbestos material.
E – Administrative (procedural) Controls	Reduce or eliminate exposure of individuals to the Asbestos materials, by adherence to procedures or instructions. The documentation should emphasize all the steps to be taken and the controls to be used in carrying out the task both safely and with minimum impact to the environment.
F – Personal Protective Equipment (PPE)	Relates only to hazards and their impact on personal safety risks. It is worn as a barrier between personnel and the Asbestos material. The success of this control procedure is dependent on the protective equipment selected, as well as fitted correctly and worn at all times when required.